OUTSULATION®



An Exterior Wall Insulation and Finish System That Incorporates Continuous Insulation

Outsulation System Installation Details




TABLE OF CONTENTS

DETAIL		DETAIL	
OUTSULATION SYSTEM	OS 0.0.01		
GRADE LEVEL - TERMINATION AT	OS 0.0.02	OUTSULATION APPLIED OVER METAL LATH	OS 0.0.29
CONCRETE CURB		AESTHETIC REVEALS	OS 0.0.30
FOUNDATION - TERMINATION ABOVE	OS 0.0.03	PROJECTING GRAPHICS	OS 0.0.31
GRADE		RECESSED GRAPHICS	OS 0.0.32
ROUGH OPENING PREPARATION	OS 0.0.04	TERMINATION AT DECK-SECTION	OS 0.0.33
PREPARATION OF OPENING FOR- STOREFRONT WINDOW	OS 0.0.05	TERMINATION AT DECK-CUT AWAY	OS 0.0.34
PREPARATION OF OPENING FOR- NAIL-ON WINDOW	OS 0.0.06	TERMINATION AT SLOPED ROOF TERMINATION AT ROOF	OS 0.0.35 OS 0.0.36
TERMINATION AT SILL	OS 0.0.07	STOP FLASHING	05 0 0 27
TERMINATION AT JAMB	OS 0.0.08	HORIZONTAL JOINT AT STONE VENEER	OS 0.0.37
TERMINATION AT HEAD	OS 0.0.09	STORE VERLEIN	
TERMINATION AT HEAD- SOLID SUBSTRATE	OS 0.0.10		
EPS PREPARATION AT WALL PENETRATIONS	OS 0.0.11		
WOOD FRAMING - EXPANSION JOINT	OS 0.0.12		
AT FLOOR LINE		NOTE	
LIGHT GAUGE FRAMING - EXPANSION JOINT AT FLOOR LINE	OS 0.0.13	DRYVIT MAKES NO REPRESENTATION SUGGESTIONS TO MODEL BUILDING CO	
TERMINATION AT PARAPET – CAP FLASHING	OS 0.0.14	SPECIFIC APPLICATIONS OR PROJECT INDICATED IN ILLUSTRATIONS, AS W	LOCATIONS. ALL COMPONENTS
TERMINATION AT PARAPET - SOLID SUBSTRATE	OS 0.0.15	REQUIRED FOR THE INTEGRITY OF THE DETAILED AND ENGINEERED BY REPR	HE SYSTEM SHALL BE DESIGNED,
PARAPET/WALL TERMINATION	OS 0.0.16	OWNER OR CONTRACTOR TO BE IN C	ONFORMANCE WITH MODEL CODES,
SOFFIT WITH FASCIA EXTENDED DRIP	OS 0.0.17	ARCHITECTURAL AND ENGINEERING R	EQUIREMENTS PERTAINING TO
SOFFIT ROUTER CUT DRIP	OS 0.0.18	SPECIFIC BUILDING PROJECTS.	
SOFFIT WITH EXPANSION JOINT	OS 0.0.19	DDVVIT MAKES NO WARRANTY EVE	DESSER OR
SOFFIT - UNINSULATED	OS 0.0.20	DRYVIT MAKES NO WARRANTY, EXPI	
OUTSIDE CORNER	OS 0.0.21	ENGINEERING, OR WORKMANSHIP OF F	•
OUTSIDE CORNER - HIGH IMPACT	OS 0.0.22	UTILIZING DRYVIT SYSTEMS OR PROD	
STRUCTURAL EXPANSION JOINT	OS 0.0.23		
OUTSULATION EXPANSION JOINT - DISSIMILAR SUBSTRATES	OS 0.0.24	THE LIABILITIES OF DRYVIT SHALL BE STATED IN THE DRYVIT STANDARD	
STRUCTURAL EXPANSION JOINT - INSIDE CORNER	OS 0.0.25	WARRANTY. CONTACT DRYVIT FOR A AND COMPLETE COPY OF THIS WARRA	
STRUCTURAL EXPANSION JOINT - OUTSIDE CORNER	OS 0.0.26		
PENETRATIONS	OS 0.0.27		
SIGN ATTACHMENT	OS 0.0.28		

Outsulation® System



APPROVED BY:	REV:	DATE:
C AW	11	05/08

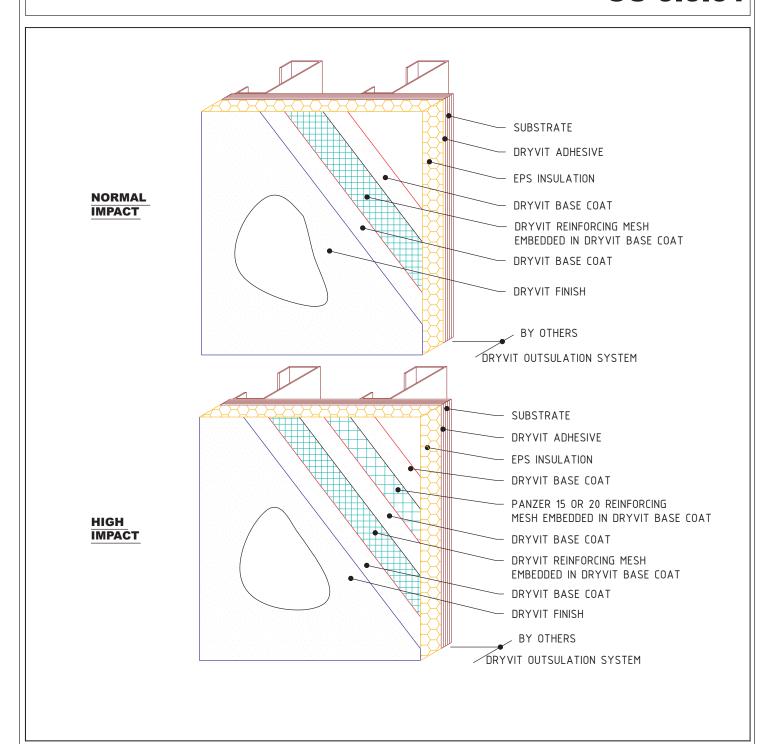

Outsulation® System


Outsulation System

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR
APPLICATIONS AND ALL FACADES EXPOSED TO
ABNORMAL STRESS, HIGH TRAFFIC, OR
DELIBERATE IMPACT HAVE THE BASE COAT
REINFORCED WITH PANZER® MESH PRIOR TO
STANDARD MESH™ OR STANDARD PLUS MESH™.
LOCATION OF HIGH IMPACT ZONES SHOULD BE
INDICATED ON CONTRACT DRAWINGS.

APPROVED BY:	REV:	DATE:
DAW	11	08/06



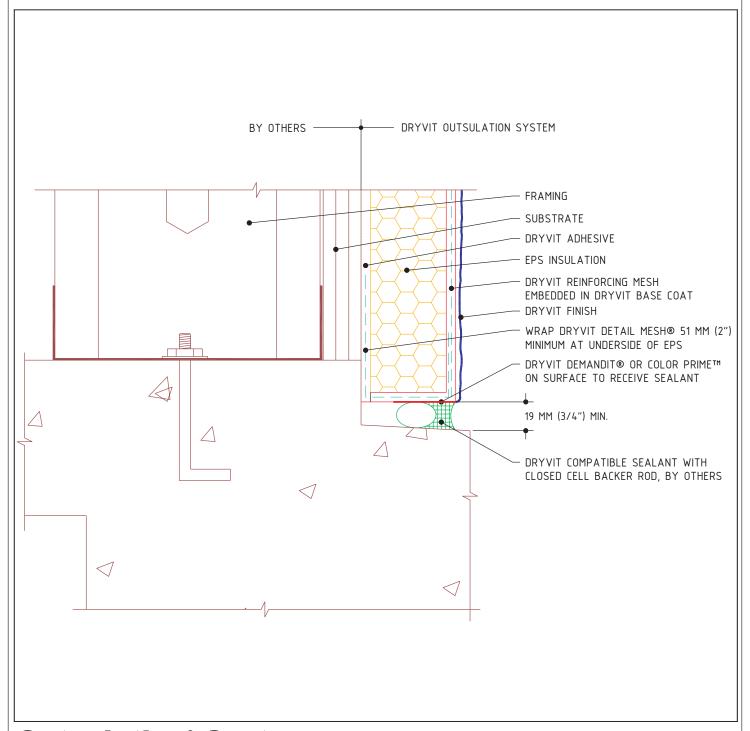

Outsulation® System


Grade Level - Termination At Concrete Curb

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR
APPLICATIONS AND ALL FACADES EXPOSED TO
ABNORMAL STRESS, HIGH TRAFFIC, OR
DELIBERATE IMPACT HAVE THE BASE COAT
REINFORCED WITH PANZER® MESH PRIOR TO
STANDARD MESH™ OR STANDARD PLUS MESH™.
LOCATION OF HIGH IMPACT ZONES SHOULD BE
INDICATED ON CONTRACT DRAWINGS.

APPROVED BY:	REV:	DATE:
DAW	12	10/06



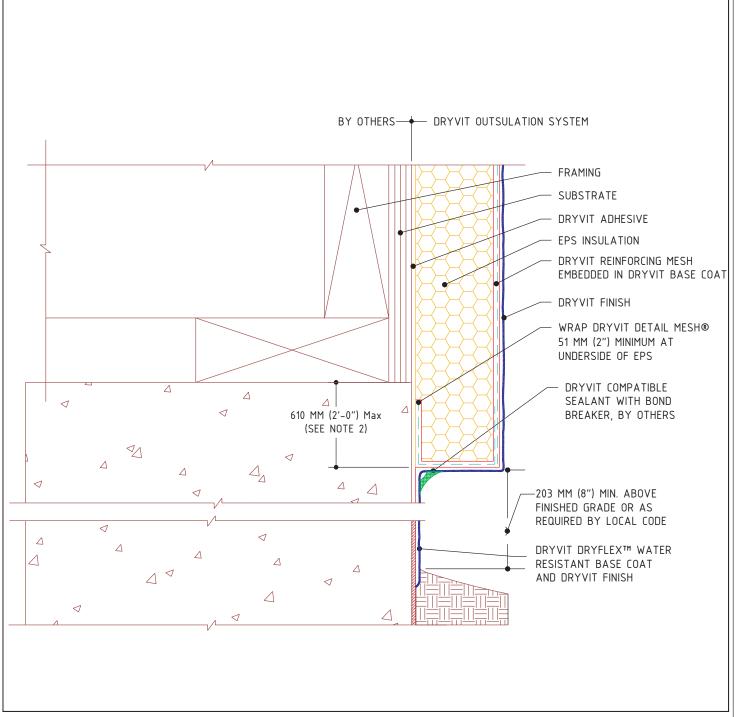

Outsulation® System


Foundation - Termination Above Grade

NOTE:


- 1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD MESH™ OR STANDARD PLUS MESH™. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
- 2. EXPANSION JOINT IS REQUIRED ALONG TOP OF FOUNDATION IF 610 MM (2'-0") DIMENSION IS EXCEEDED.
- 3. SLOPE GRADE AWAY FROM WALL.
- 4. STOP FINISH APPROXIMATELY 51 MM (2") BELOW GRADE.



APPROVED BY:	REV:	DATE:
DAW	11	08/06




APPLY DRYVIT AQUAFLASH® SYSTEM AT SILL, EXTENDING UP JAMBS MINIMUM 64 MM (2 ½") AND INSTALL CORNER SPLICES (SEE NOTE 3)



APPLY DRYVIT AQUAFLASH SYSTEM AT JAMBS LAPPING OVER SILL APPLICATION (SEE NOTE 3)

STEP #2



APPLY DRYVIT AQUAFLASH SYSTEM AT HEAD LAPPING OVER JAMB APPLICATION (SEE NOTE 3)

Outsulation® System


NOTE:


- 1. DRYVIT AQUAFLASH SHALL EXTEND TO 3. DRYVIT FLASHING TAPE SURFACE INTERIOR FACE OF FRAMING.
- 2. REFER TO OS 0.0.05, 0.0.06 FOR INTEGRATION OF SILL FLASHING.
- CONDITIONER™ AND DRYVIT FLASHING TAPETM MAY BE USED IN LIEU OF AQUAFLASH SYSTEM.


Rough Opening Preparation




APPROVED BY:	REV:	DATE:
RS	3	05/06

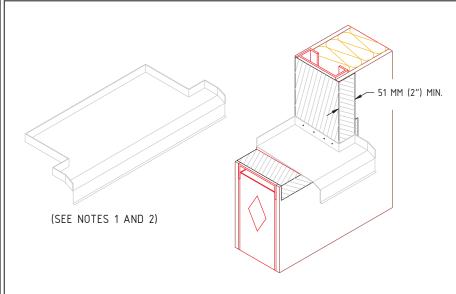






STEP 2:APPLY DRYVIT AQUAFLASH® SYSTEM
SPLICES OVER UPTURNED LEGS OF PAN
FLASHING (SEE NOTE 3)



STEP 3: INSTALL WINDOW UNIT AND ASSOCIATED HEAD FLASHING. (SEE DETAIL 0.0.09)

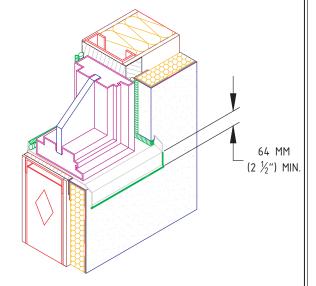

STEP 4:INSTALL EIFS AND APPLY BACKER ROD AND SEALANT ALONG JAMBS AND AT SYSTEM TERMINATIONS, ALSO ALONG EDGES OF FLASHING.

Outsulation® System


Preparation of Opening for Storefront Window


NOTES


- PAN FLASHING SHOULD OVERLAP EIFS MIN. 2 1/2" MEASURED FROM THE TOP OF THE EPS
- 2. PAN FLASHING MUST HAVE WATERTIGHT SEAMS
- 3. DRYVIT FLASHING TAPE SURFACE CONDITIONER™
 AND DRYVIT FLASHING TAPE™ MAY BE USED IN
 LIEU OF AQUAFLASH SYSTEM.

APPROVED BY:	REV:	DATE:
RS	4	05/06








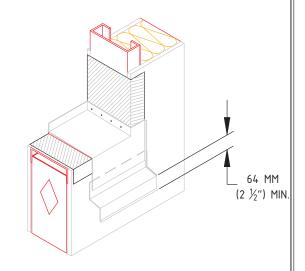



(SEE NOTES 1,2 AND 5)

STEP 1: APPLY DRYVIT AQUAFLASH® SYSTEM AT SILL PER OS 0.0.04 AND SECURE FLASHING TO FRAMING (SEE NOTES 1,2,5 AND 7)

STEP 2: INSTALL SILL PAN FLASHING. SHIM UNDERSIDE OF PAN FLASHING TO ENSURE WATER RUN OFF (SEE NOTE 2)







STEP 3: APPLY DRYVIT AQUAFLASH SYSTEM OVER METAL FLASHING TRANSITION AND AT JAMBS LAPPING OVER UPTURNED LEGS OF PAN FLASHING (SEE NOTES 1,2,5 AND 7)

STEP 4: INSTALL WINDOW UNIT AND STEP 5: INSTALL EIFS AND APPLY BACKER ROD AND ASSOCIATED HEAD FLASHING.

SEALANT ALONG JAMBS AND AT SYSTEM TERMINATIONS, ALSO ALONG EDGES OF FLASHING (SEE NOTES 3,4,5 AND 6)

Outsulation® System

Preparation of Opening for Nail-On Window

NOTES

- 1. PAN FLASHING SHOULD OVERLAP EIFS MIN. 64 MM (2 1/2") MEASURED FROM THE TOP OF THE
- 2.PAN FLASHING MUST HAVE WATER TIGHT SEAMS
- 3. MECHANICAL FASTENERS SHOULD BE USED TO ATTACH SILL TRIM PIECE
- 4.EIFS AT SILL SHALL BE SLOPED FOR DRAINAGE.

APPROVED BY

- 5. APPLY DRYVIT AQUAFLASH SYSTEM AT SILL. (SEE DETAIL OS 0.0.04)
- 6. ADHESIVE ONLY APPLICATION IS ACCEPTABLE WHEN USING THE AQUAFLASH SYSTEM
- CONDITIONER™ AND DRYVIT FLASHING TAPET MAY BE USED IN LIEU OF AQUAFLASH SYSTEM.


DATE 05/06

7. DRYVIT FLASHING TAPE SURFACE

Dryvit products is the responsibility of the project's design professional. All systems must comply with local building codes and standards. This detail is for general information and guidance only and Dryvit specifically disclaims any liability for the use of this detail and for the architecture, design, engineering or workmanship of any project. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent alternative is best suited for the project. Use of a functionally equivalent detail does not violate Dryvit's warranty. This detail is subject to change without notice. Contact Dryvit to insure you have the most recent

The architecture, engineering and design of the project using the



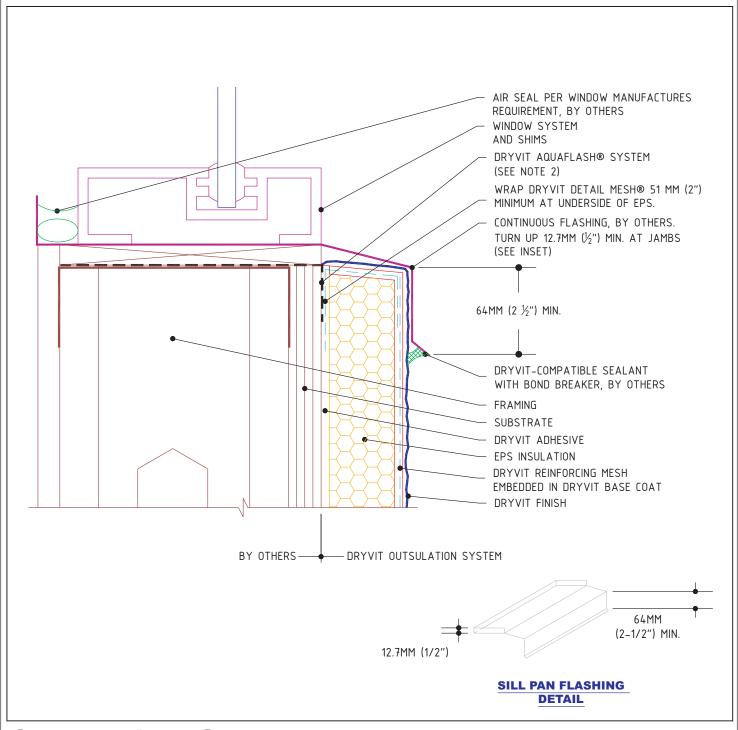

Outsulation® System

APPROVED BY:


Termination at Sill

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD MESH™ OR STANDARD PLUS MESH™. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.

2. DRYVIT FLASHING TAPE SURFACE CONDITIONER™ AND DRYVIT FLASHING TAPE™ MAY BE USED IN LIEU OF AQUAFLASH SYSTEM.



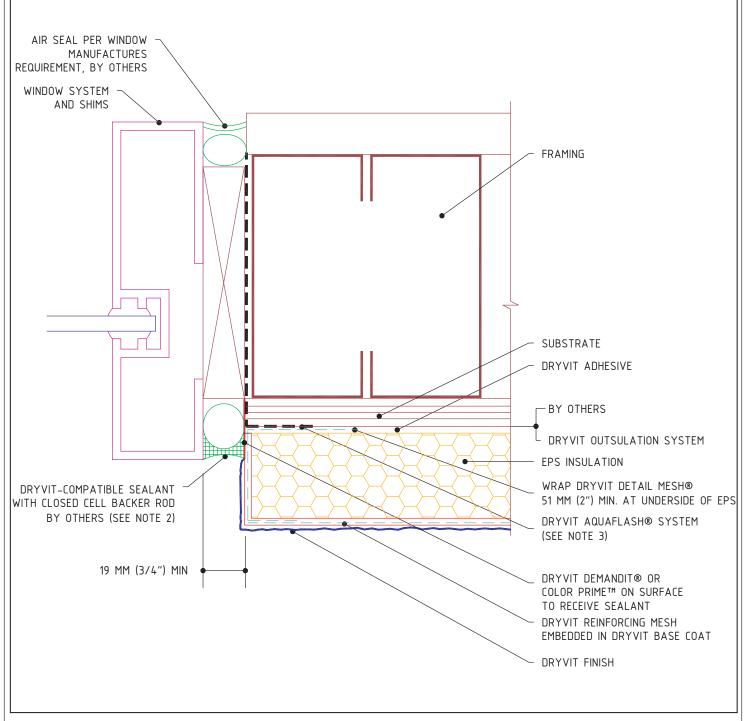

Outsulation® System

Termination at Jamb


NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD MESH™ OR STANDARD PLUS MESH™. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.

- 2. SEALANT SHOULD NOT BE IN DIRECT CONTACT WITH FLASHING TAPE ADHESIVE; STAINING COULD OCCUR.
- 3. DRYVIT FLASHING TAPE SURFACE CONDITIONER™ AND DRYVIT FLASHING TAPE™ MAY BE USED IN LIEU OF AQUAFLASH SYSTEM.



APPROVED BY:	REV:	DATE:
RS	13	08/06

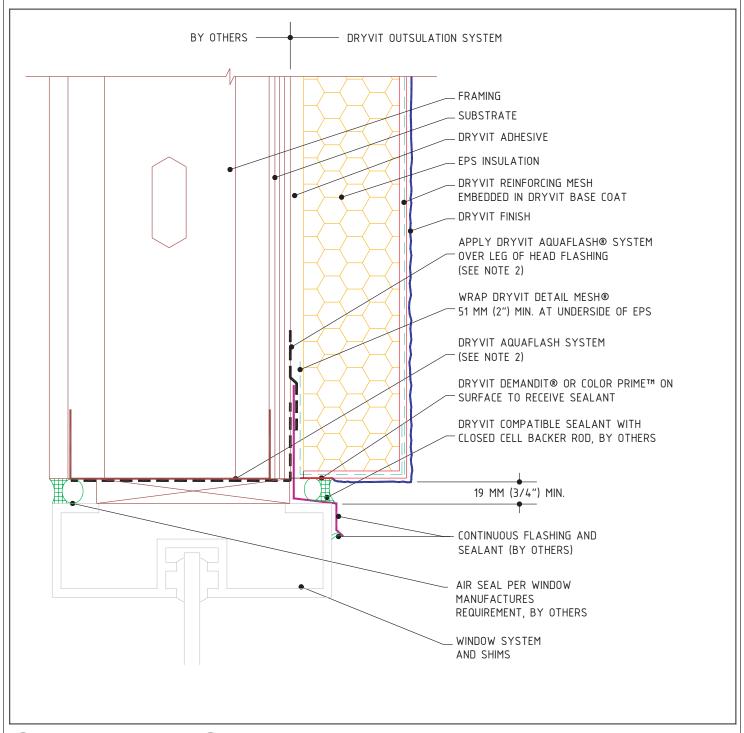

Outsulation® System

APPROVED BY:


Termination at Head

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD MESH™ OR STANDARD PLUS MESH™. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.

2. DRYVIT FLASHING TAPE SURFACE CONDITIONER™ AND DRYVIT FLASHING TAPE™ MAY BE USED IN LIEU OF AQUAFLASH SYSTEM.



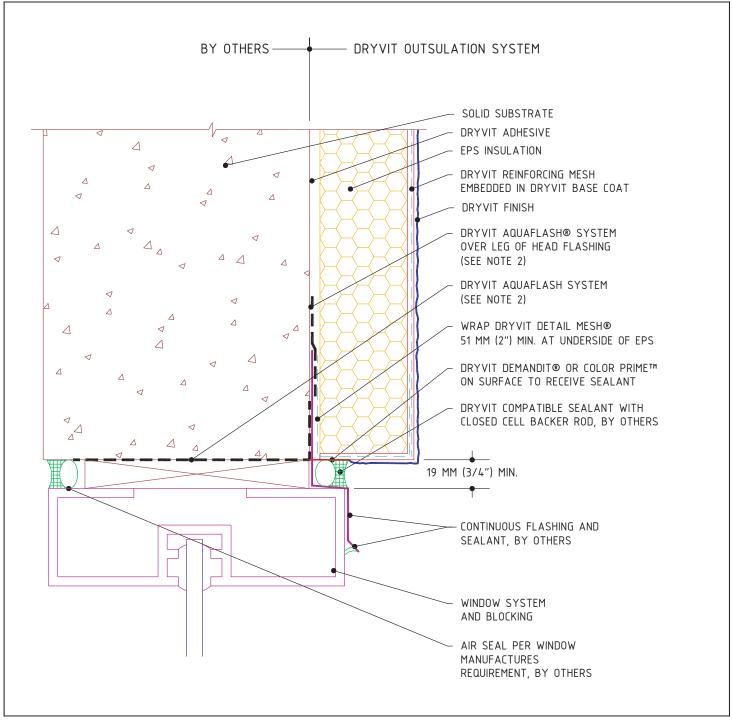

Outsulation® System

Termination at Head-Solid Substrate


NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD MESH™ OR STANDARD PLUS MESH™. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.

2. DRYVIT FLASHING TAPE SURFACE CONDITIONER™ AND DRYVIT FLASHING TAPE™ MAY BE USED IN LIEU OF AQUAFLASH SYSTEM.



APPROVED BY:	REV:	DATE:
DAW	12	08/06

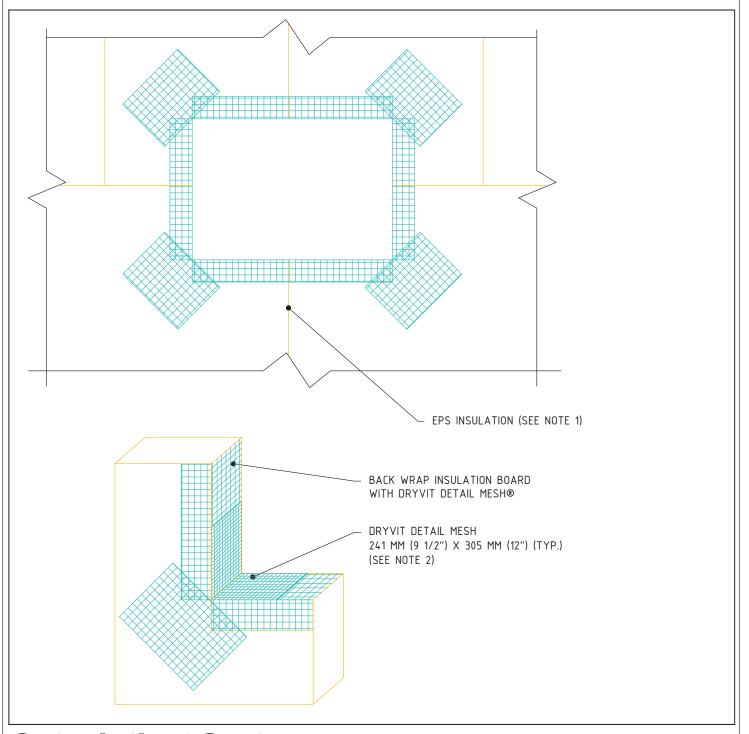

Outsulation® System

EPS Preparation at Wall Penetrations

NOTES:

- 1. LOCATE INSULATION BOARDS SUCH THAT BOARD EDGES DO NOT ALIGN WITH CORNERS OF PENETRATION.
- APPLY A PIECE OF 241 MM (9 1/2") X 305 MM (12") DETAIL REINFORCING MESH DIAGONALLY AT EACH CORNER.


 APPROVED BY:
 REV:
 DATE:

 DAW
 11
 05/06

The architecture, engineering and design of the project using the Dryvit products is the responsibility of the project's design professional. All systems must comply with local building codes and standards. This detail is for general information and guidance only and Dryvit specifically disclaims any liability for the use of this detail and for the architecture, design, engineering or workmanship of any project. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent alternative

discretion, whether this detail or a functionally equivalent alternative is best suited for the project. Use of a functionally equivalent detail does not violate Dryvit's warranty. This detail is subject to change without notice. Contact Dryvit to insure you have the most recent version.



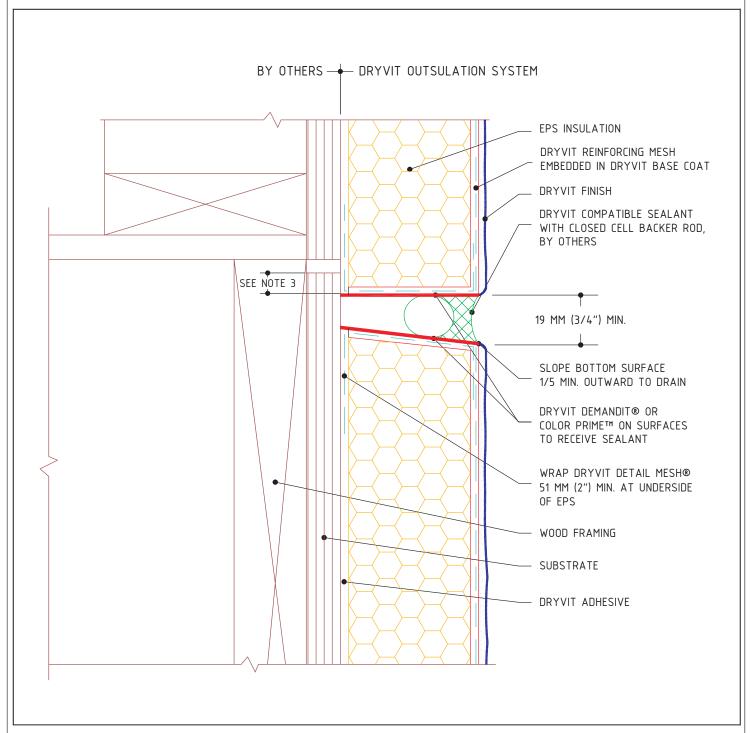

Outsulation® System


Wood Framing - Expansion Joint At Floor Line

NOTE:

- 1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD MESHIM OR STANDARD PLUS MESHIM. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
- 2. EXPANSION JOINT IS INTENDED TO ACCOMMODATE CROSS GRAIN SHRINKAGE OF FLOOR BEAMS.
- 3. LOCATE EXTERNAL SEALANT JOINT WITHIN 51 MM (2") BELOW BREAK IN SHEATHING.



APPROVED BY:	REV:	DATE:
DAW	11	08/06

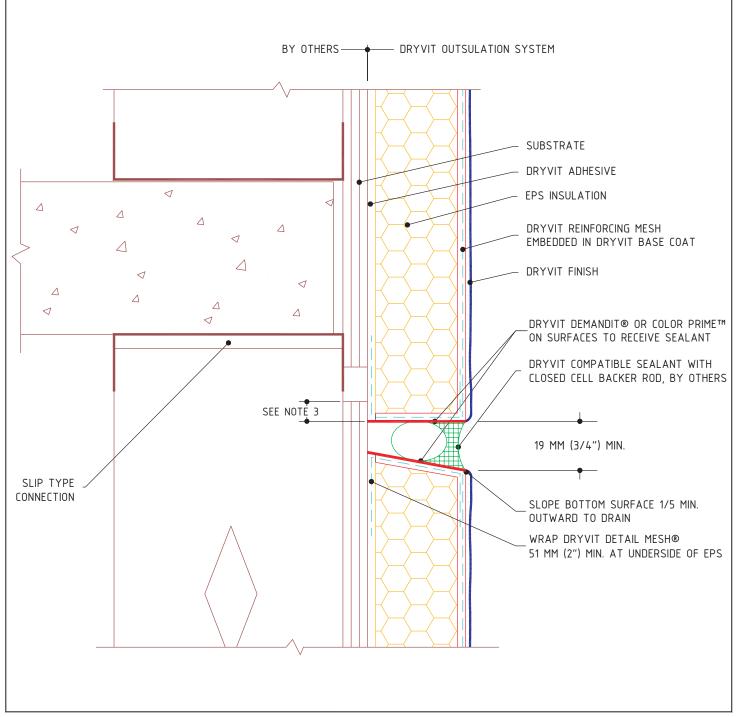

Outsulation® System


Light Gauge Framing - Expansion Joint At Floor Line

NOTE:

- 1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD MESH™ OR STANDARD PLUS MESH™. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
- 2. EXPANSION JOINT IS INTENDED TO ACCOMMODATE MOVEMENT AT SLIP CONNECTION.
- 3. LOCATE EXTERNAL SEALANT JOINT WITHIN 51 MM (2") BELOW BREAK IN SHEATHING.



APPROVED BY:	REV:	DATE:
DAW	11	08/06

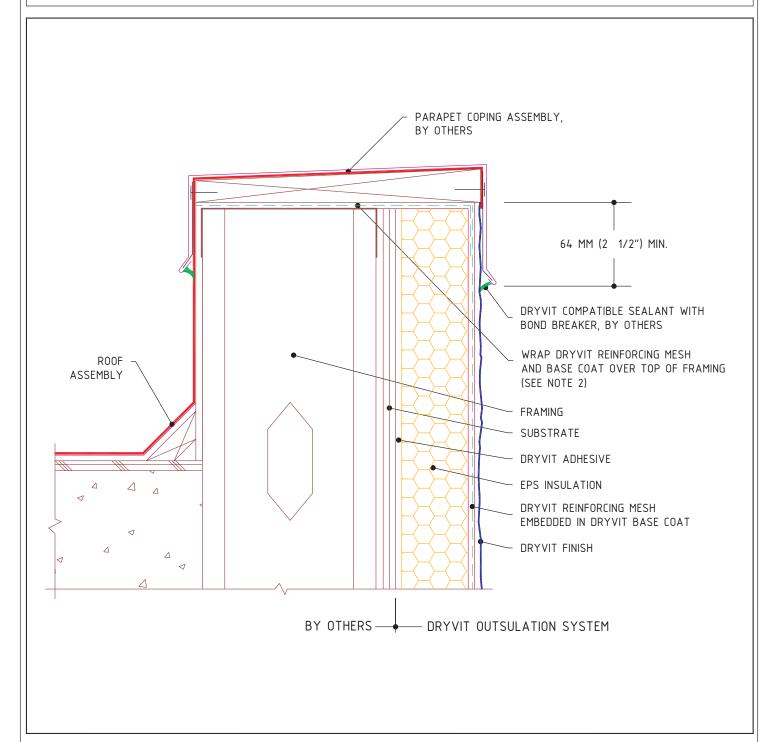

Outsulation® System

Termination at Parapet-Cap Flashing

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD MESH™ OR STANDARD PLUS MESH™. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.

2. AS AN OPTION, DRYVIT AQUAFLASH®

SYSTEM OR DRYVIT FLASHING TAPE

SURFACE CONDITIONER™ AND DRYVIT


FLASHING TAPE™ MAY BE USED TO

PROVIDE ADDITIONAL PROTECTION AT THE

TOP OF A PARAPET WALL.



APPROVED BY:	REV:	DATE:
DAW	12	08/06

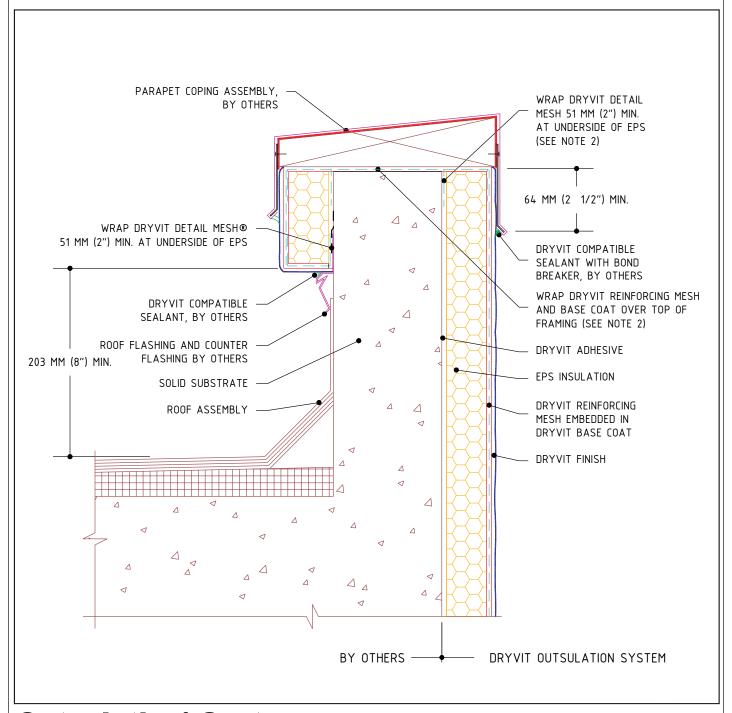

Outsulation® System

Termination at Parapet - Solid Substrate

NOTE:

- 1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD MESH™ OR STANDARD PLUS MESH™. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
- 2. AS AN OPTION, DRYVIT AQUAFLASH®

 SYSTEM OR DRYVIT FLASHING TAPE

 SURFACE CONDITIONER™ AND DRYVIT


 FLASHING TAPE™ MAY BE USED TO

 PROVIDE ADDITIONAL PROTECTION AT THE

 TOP OF A PARAPET WALL.



APPROVED BY:	REV:	DATE:
RS	1/4	08/07

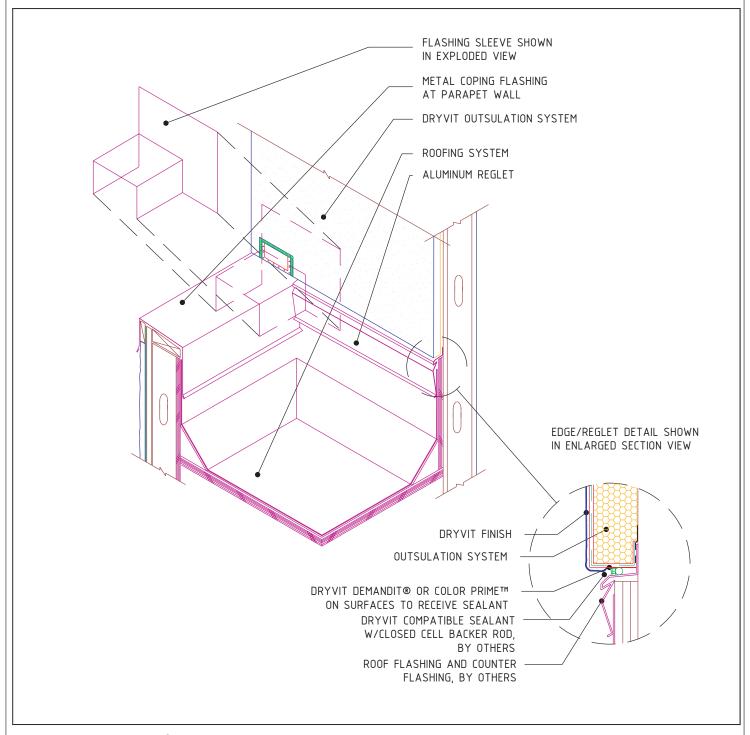

Outsulation® System


Parapet/Wall Termination

NOTE:

- 1. APPLY AQUAFLASH® SYSTEM OR FLASHING TAPE™ AT WALL/SLEEVE TRANSITION.
- 2. FLASHINGS SHALL BE CONFIGURED AND INSTALLED IN A WATER TIGHT FASHION PRIOR TO OUTSULATION INSTALLATION



APPROVED BY:	REV:	DATE:
RS	7	05/06

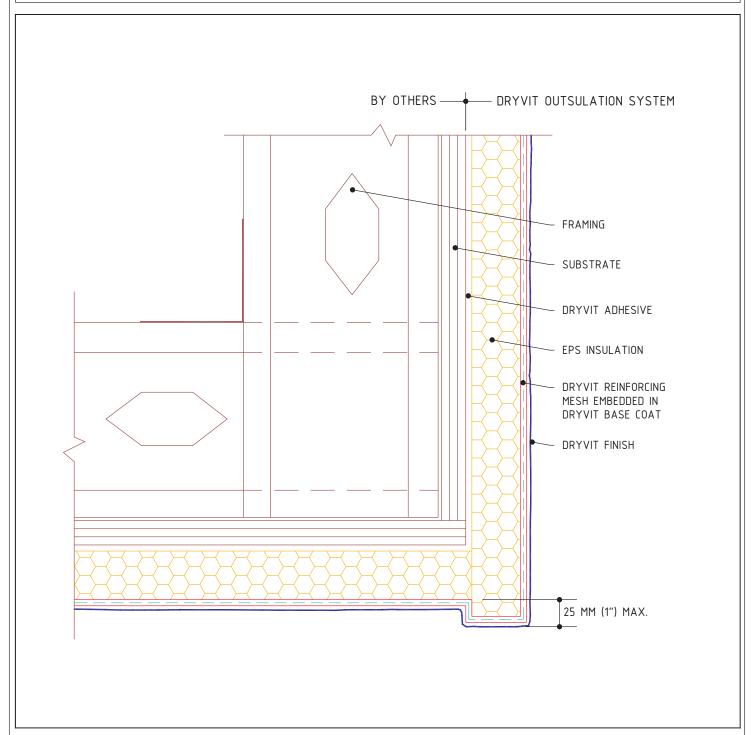

Outsulation® System


NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD MESH™ OR STANDARD PLUS MESH™. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.

APPROVED BY:	REV:	DATE:
DAW	12	08/06

Soffit With Fascia Extended Drip



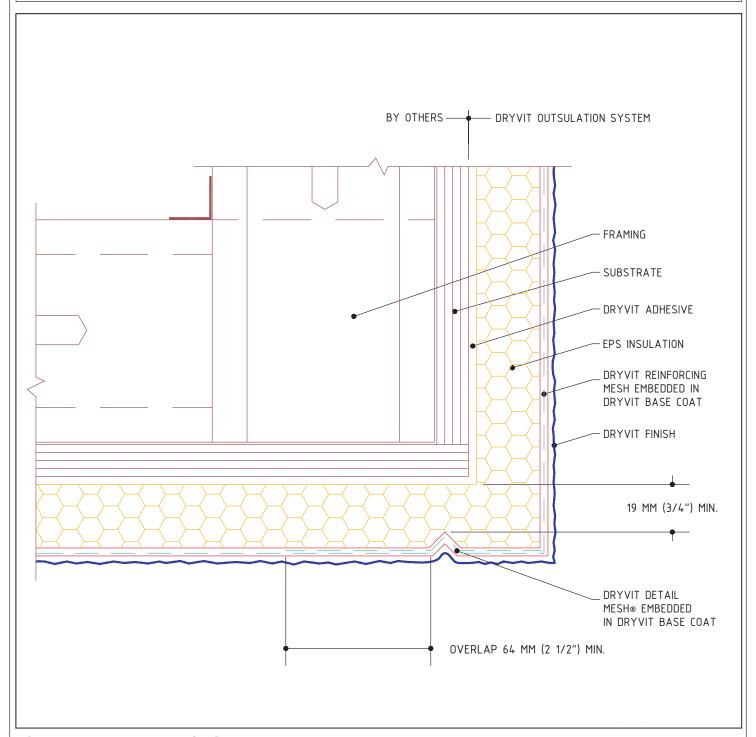

Outsulation® System


Soffit Router Cut Drip

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD MESH™ OR STANDARD PLUS MESH™. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.

APPROVED BY:	REV:	DATE:
DAW	12	08/06



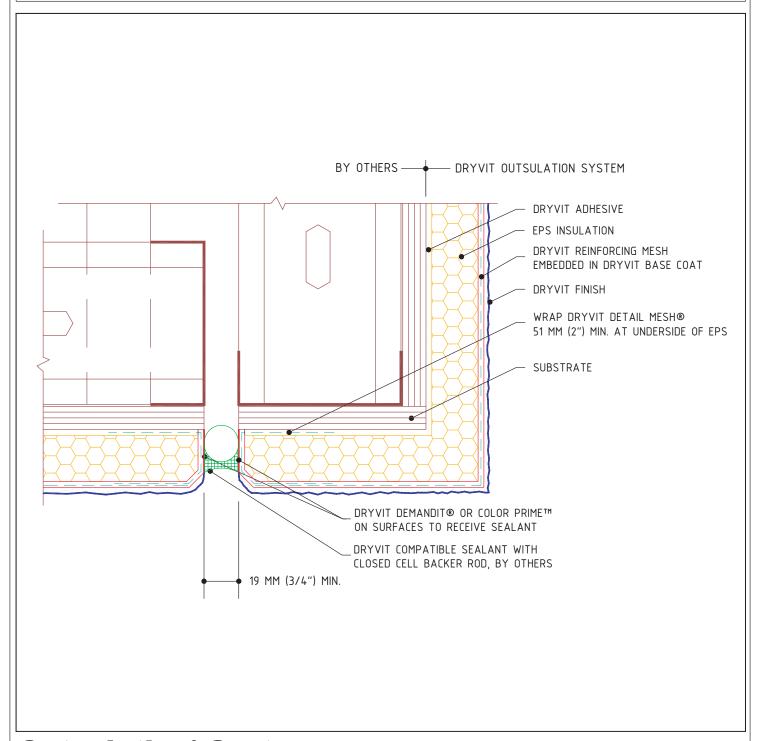

Outsulation® System


Soffit With Expansion Joint

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD MESH™ OR STANDARD PLUS MESH™. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.

APPROVED BY:	REV:	DATE:
DAW	12	08/06



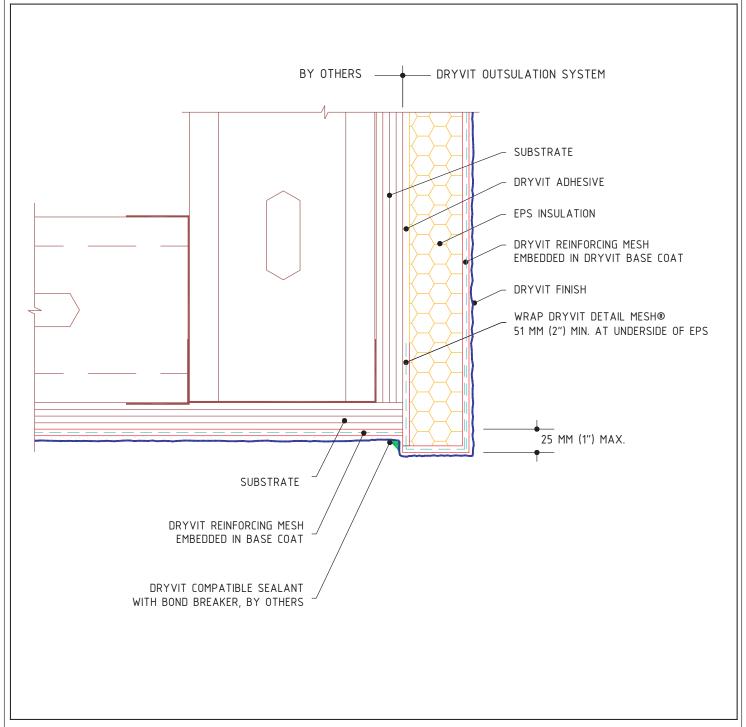

Outsulation®System


Soffit - Uninsulated

NOTE:

- 1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD MESH™ OR STANDARD PLUS MESH™. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
- 2. SOFFITS WITHOUT EPS INSULATION REQUIRE EXPANSION JOINTS EVERY 6.096 M (20 FT).
- 3. REFER TO DRYVIT PUBLICATION DS 173, FOR APPLICATION ON EXTERIOR SOFFITS.



APPROVED BY:	REV:	DATE:
DAW	12	08/06

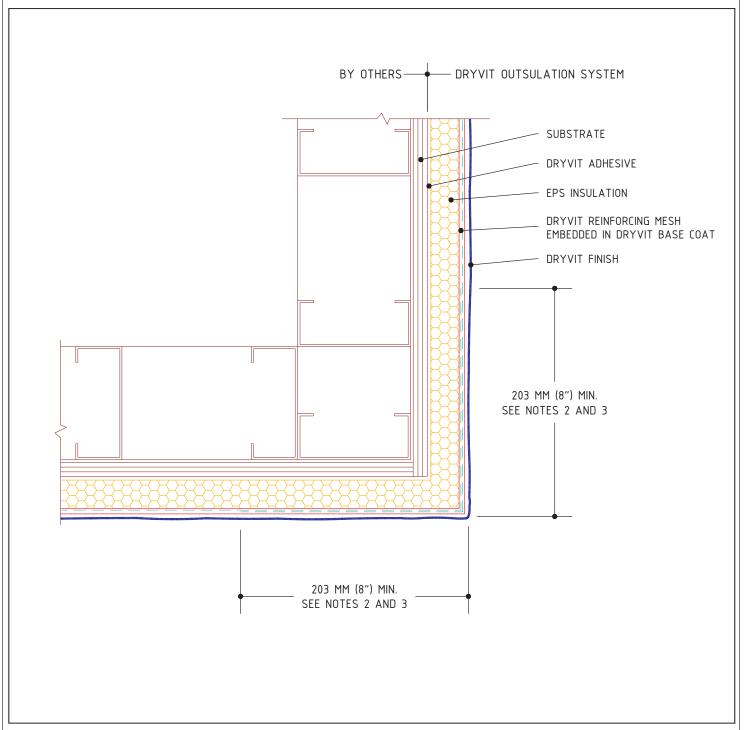

Outsulation® System


Outside Corners

NOTE:

- 1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD MESH™ OR STANDARD PLUS MESH™. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.
- 2. DOUBLE WRAP OUTSIDE CORNERS WITH REINFORCING MESH OR USE CORNER MESH.
- 3. DO NOT LAP REINFORCING MESH WITHIN 203 MM (8") OF A CORNER.



APPROVED BY:	REV:	DATE:
DAW	12	08/06

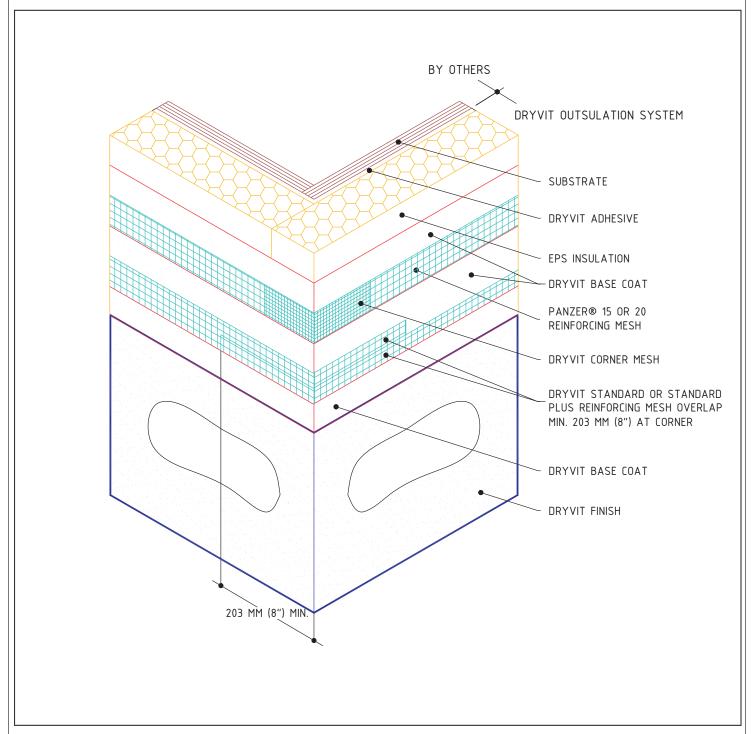

Outsulation® System


NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD MESHIM OR STANDARD PLUS MESHIM. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.

APPROVED BY:	REV:	DATE:
DAW	12	08/06

Outside Corner - High Impact



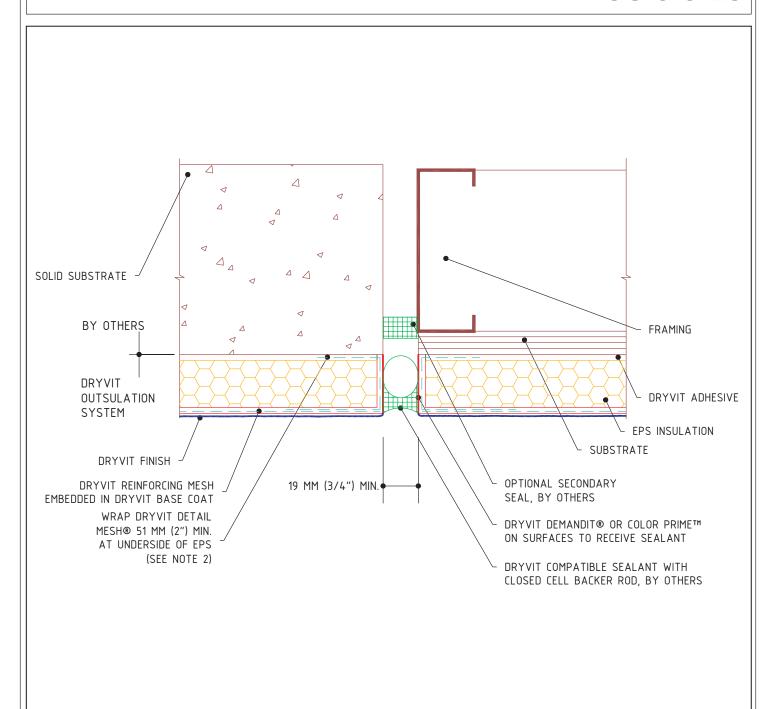

Outsulation® System

Structural Expansion Joint


NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD MESH™ OR STANDARD PLUS MESH™. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.

 AS AN OPTION, THE REINFORCED BASE COAT EDGE WRAP MAY BE EXTENDED ONTO THE CONCRETE EDGE AND/OR FRAMING.



Γ	APPROVED BY:	REV:	DATE:
t	DAW.	13	08/06

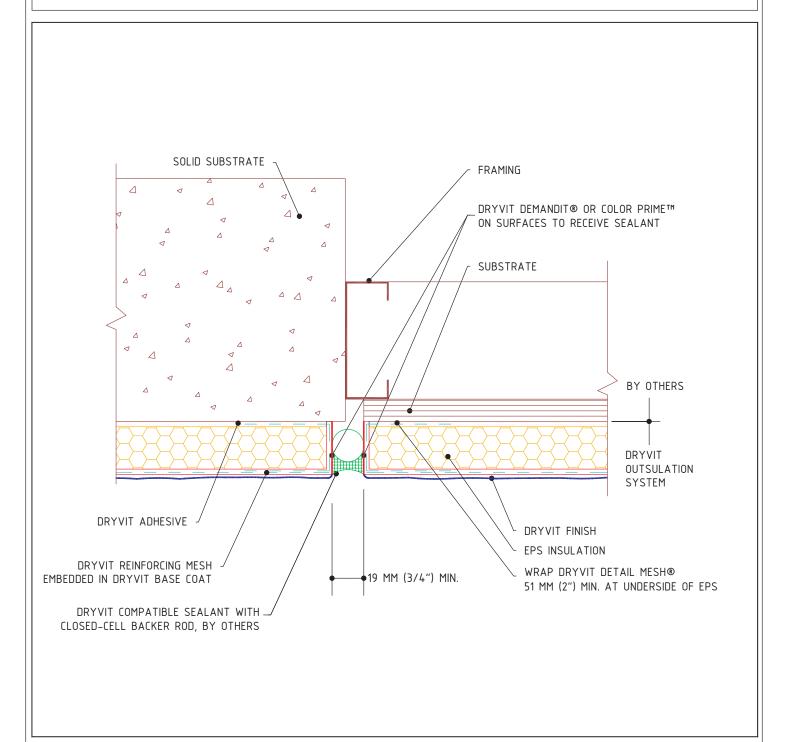

Outsulation® System


Outsulation Expansion Joint - Dissimilar Substrates

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD MESH™ OR STANDARD PLUS MESH™. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.

APPROVED BY:	REV:	DATE:
DAW	12	08/06



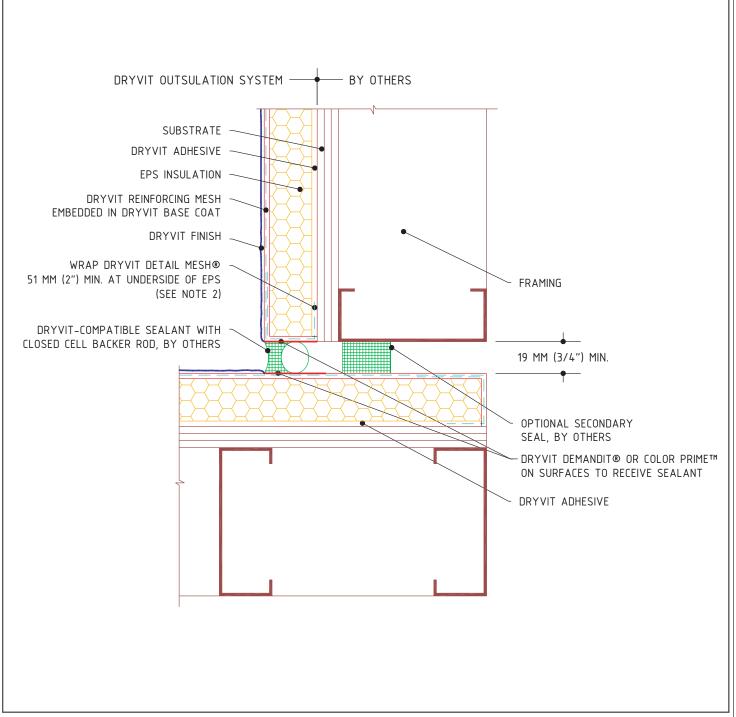

Outsulation® System

Structural Expansion Joint - Inside Corner


NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD MESH™ OR STANDARD PLUS MESH™. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.

2. AS AN OPTION, THE REINFORCED BASE COAT EDGE WRAP MAY BE EXTENDED ONTO THE FRAMING.



APPROVED BY:	REV:	DATE:
RS	14	08/06

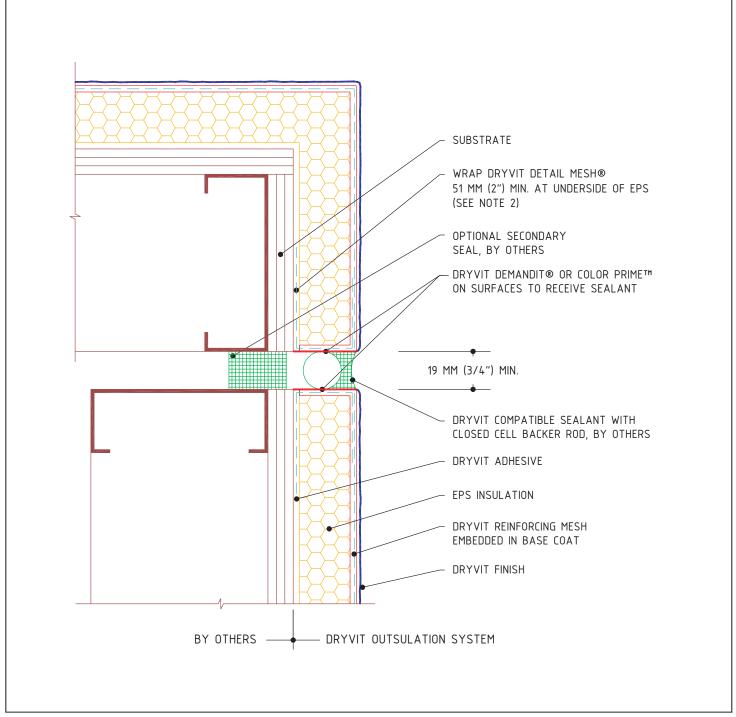

Outsulation® System

Structural Expansion Joint - Outside Corner


NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD MESHIM OR STANDARD PLUS MESHIM. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.

AS AN OPTION, THE REINFORCED BASE COAT EDGE WRAP MAY BE EXTENDED ONTO THE FRAMING.



APPROVED BY:	REV:	DATE:
RS	13	08/06

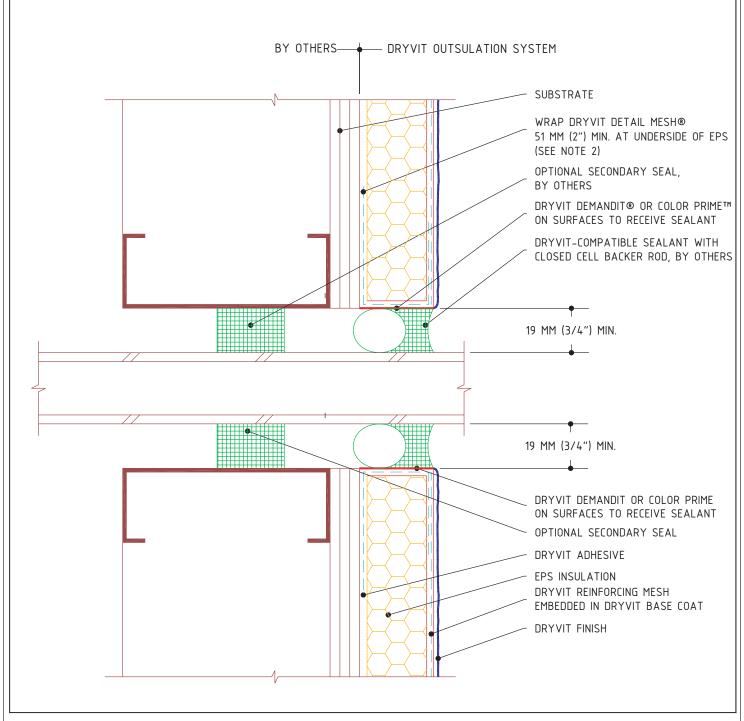

Outsulation® System


Penetrations

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD MESH™ OR STANDARD PLUS MESH™. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.

2. AS AN OPTION, THE REINFORCED BASE COAT EDGE WRAP MAY BE EXTENDED ONTO THE FRAMING.



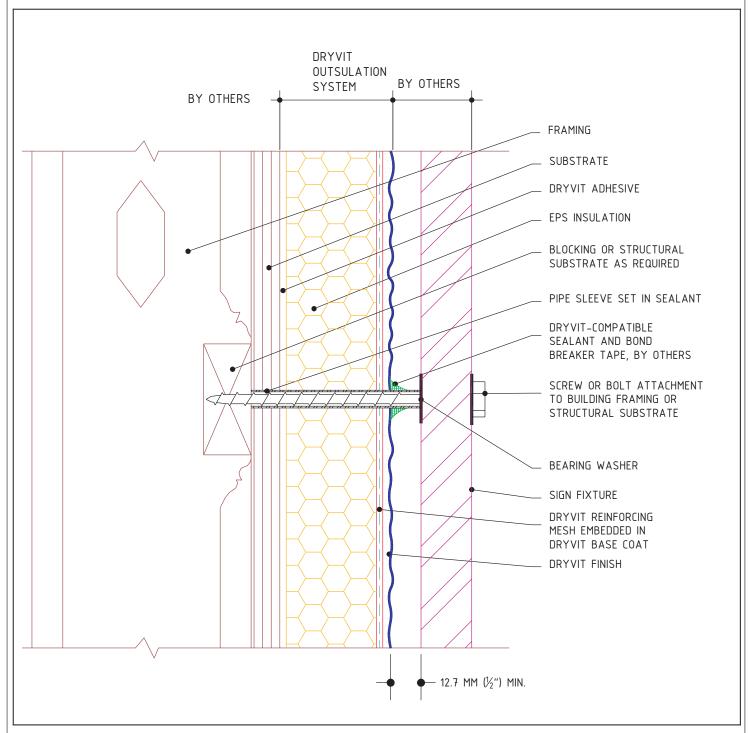

Outsulation® System


Sign Attachment

NOTE:

1. PERIMETER OF PIPE SLEEVE IS CAULKED TO PREVENT WATER ENTRY INTO WALL.



APPROVED BY:	REV:	DATE:
DAW	12	05/06

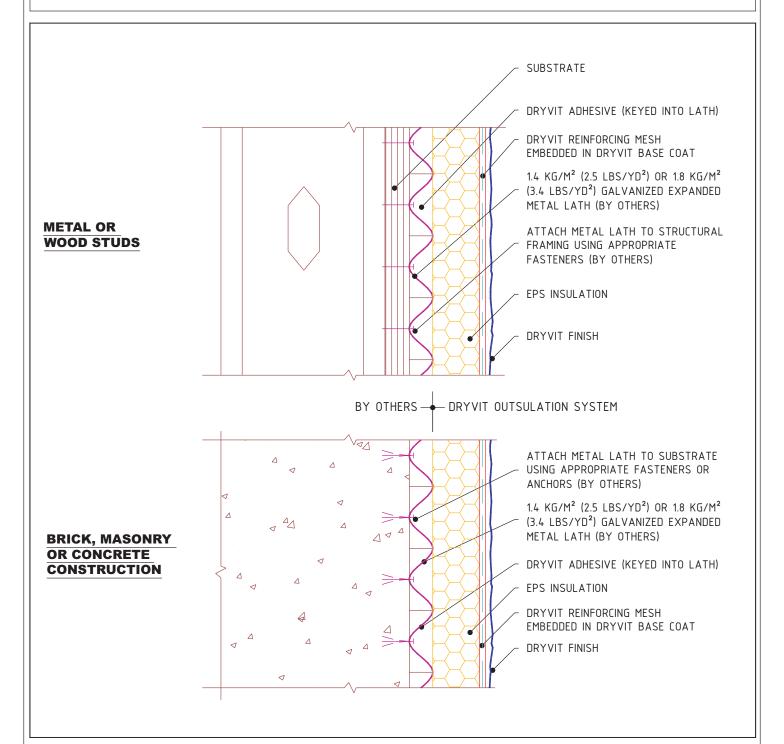

Outsulation® System


Outsulation Applied Over Metal Lath

NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD MESH™ OR STANDARD PLUS MESH™. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.

APPROVED BY:	REV:	DATE:
DAW	12	08/06



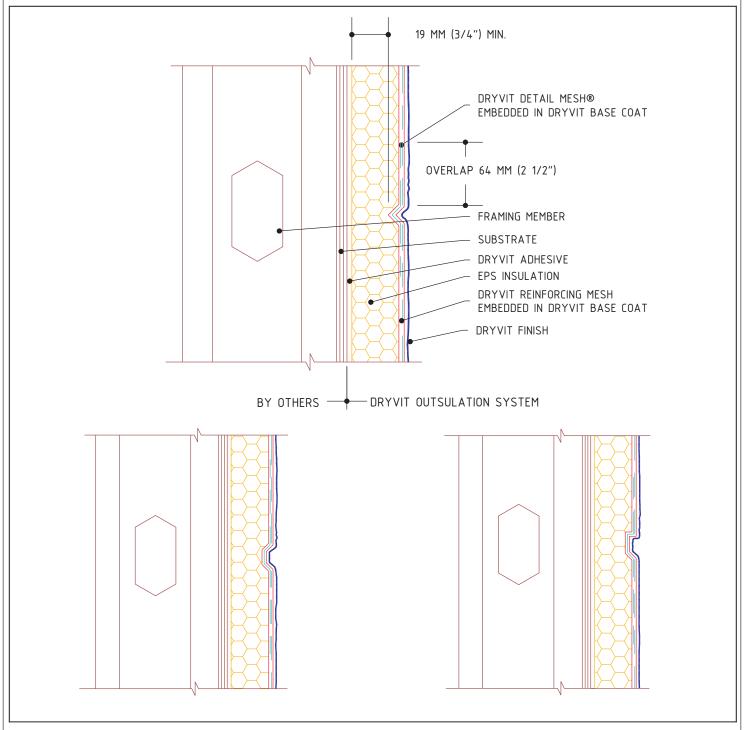

Outsulation® System

Aesthetic Reveals


NOTE:

1. DRYVIT RECOMMENDS THAT GROUND FLOOR APPLICATIONS AND ALL FACADES EXPOSED TO ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE IMPACT HAVE THE BASE COAT REINFORCED WITH PANZER® MESH PRIOR TO STANDARD MESH™ OR STANDARD PLUS MESH™. LOCATION OF HIGH IMPACT ZONES SHOULD BE INDICATED ON CONTRACT DRAWINGS.

2. SLOPE BOTTOM EDGE OF REVEAL FOR POSITIVE DRAINAGE.



APPROVED BY:	REV:	DATE:
DAW	12	08/06

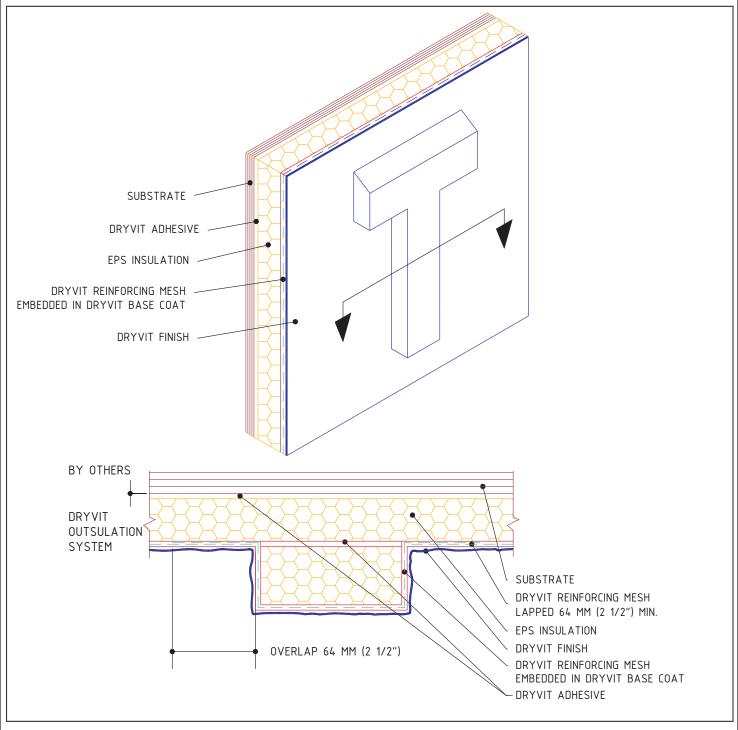

Outsulation® System

Projecting Graphics


NOTE:

- 1. MAXIMUM THICKNESS OF EPS BUILT OUT SHAPES SHALL NOT EXCEED 305 MM (12 INCHES) AT ANY POINT MEASURED FROM THE SUBSTRATE
- 2. PERCENTAGE OF WALL AREA COVERED BY EPS FOAM SHAPES IN EXCESS OF 102 MM (4 IN.) IN THICKNESS SHALL NOT EXCEED 15%

 APPROVED BY:
 REV:
 DATE:

 DAW
 12
 05/06



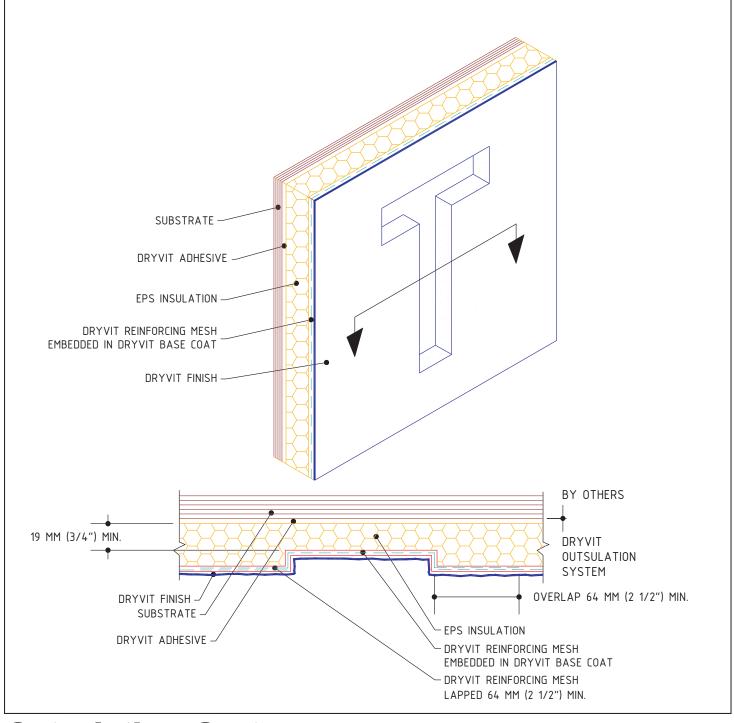

Outsulation® System


Recessed Graphics

NOTES:

1. SLOPE BOTTOM EDGE OF HORIZONTAL RECESSES FOR POSITIVE DRAINAGE



APPROVED BY:	REV:	DATE:
DAW	11	05/06

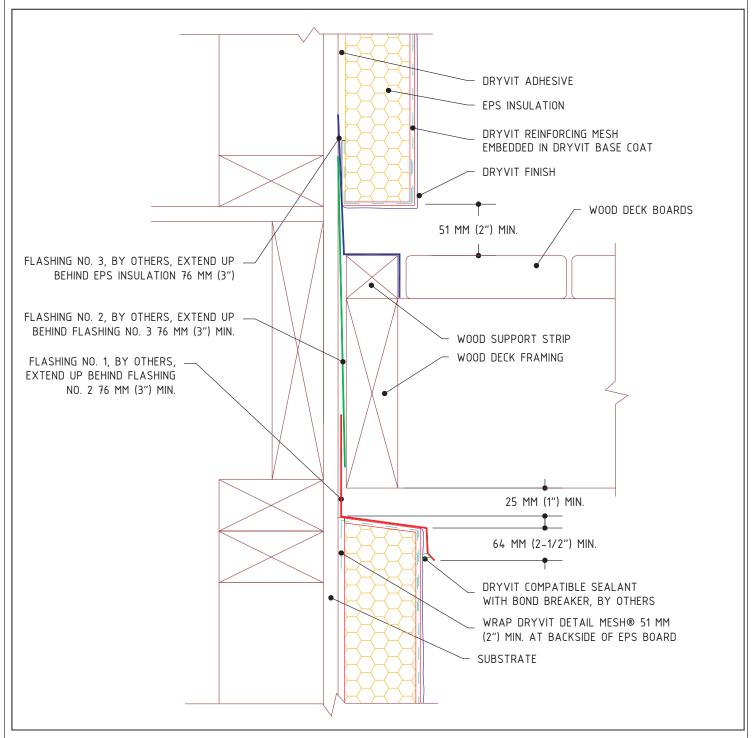

Outsulation® System

Termination at Deck - Section

The architecture, engineering and design of the project using the Dryvit products is the responsibility of the project's design

professional. All systems must comply with local building codes and

standards. This detail is for general information and guidance only


and Dryvit specifically disclaims any liability for the use of this detail and for the architecture, design, engineering or workmanship

NOTE:

- 1. THESE DETAILS DO NOT APPLY TO CANTILEVERED DECKS. CANTILEVERED DECKS CUTAWAY DETAIL. REQUIRE JOB SPECIFIC FLASHING DETAILS.
- 2. WHEN FLASHING NUMBER 1 IS IN PLACE, EPS WILL NEED TO BE PRE WRAPPED WITH BASE COAT AND MESH.
- 3. REFER TO OS 0.0.34 FOR DECK

of any project. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent alternative is best suited for the project. Use of a functionally equivalent detail does not violate Dryvit's warranty. This detail is subject to change without notice. Contact Dryvit to insure you have the most recent

APPROVED BY:	REV:	DATE:
DAW	6	05/06

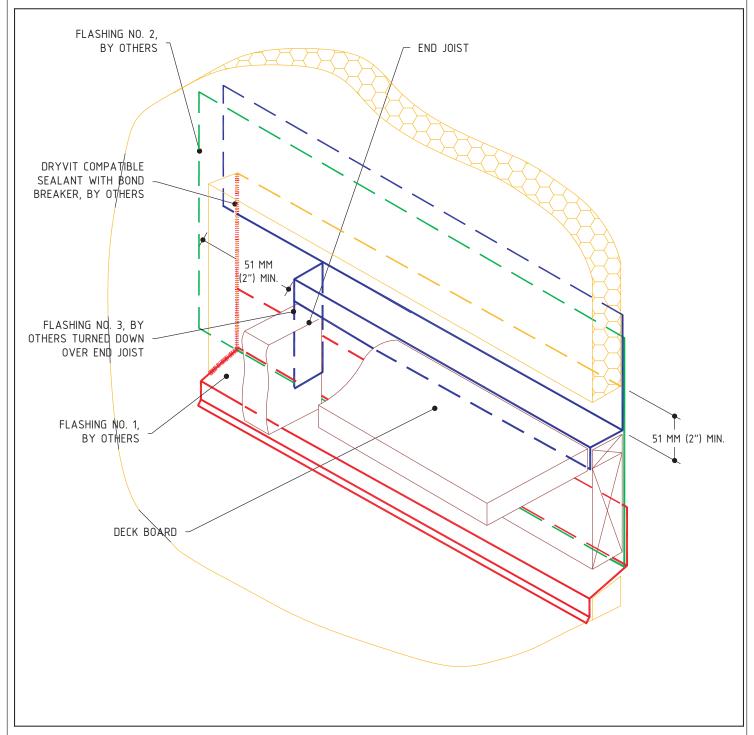



Outsulation® System

Termination at Deck - Cut Away

NOTES:

- 1. THESE DETAILS DO NOT APPLY TO CANTILEVERED DECKS. CANTILEVERED DECKS REQUIRE JOB SPECIFIC FLASHING DETAILS.
- 2.REFER TO OS 0.0.33 FOR DECK SECTION DETAIL.



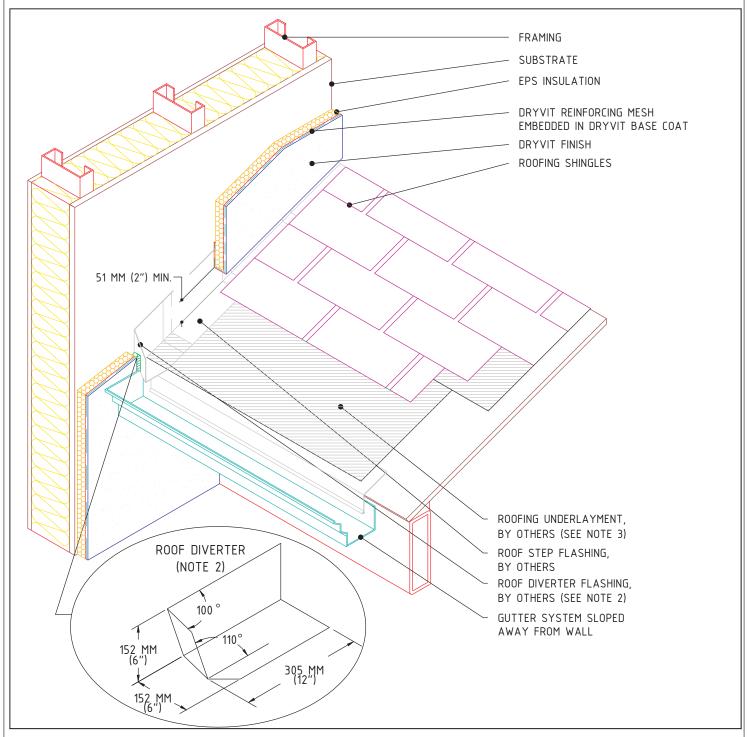


Outsulation® System


NOTE:

- EXTEND DIVERTER FLASHING (KICKOUT) A MINIMUM OF 25 MM (1") BEYOND FACE OF SYSTEM.
- ROOF DIVERTER TO BE MADE FROM CORROSION RESISTANT MATERIAL MIN. 24 GAGE WITH WATER TIGHT SEAMS.
- 3. EXTEND ROOFING UNDERLAYMENT 127 MM (5") UP VERTICAL WALL BEHIND METAL FLASHING.
- 4. METAL FLASHINGS ARE 254 MM (10") X 51 MM (2") LONGER THAN THE EXPOSED PORTION OF THE ROOFING SHINGLE AND ARE BENT IN HALF TO ALLOW FOR TWO 127 MM (5") LEGS.

 ALTHOUGH NOT SHOWN, METAL FLASHINGS ARE STEP FLASHED (INTERWOVEN) WITH ROOFING SHINGLES.

Termination at Sloped Roof



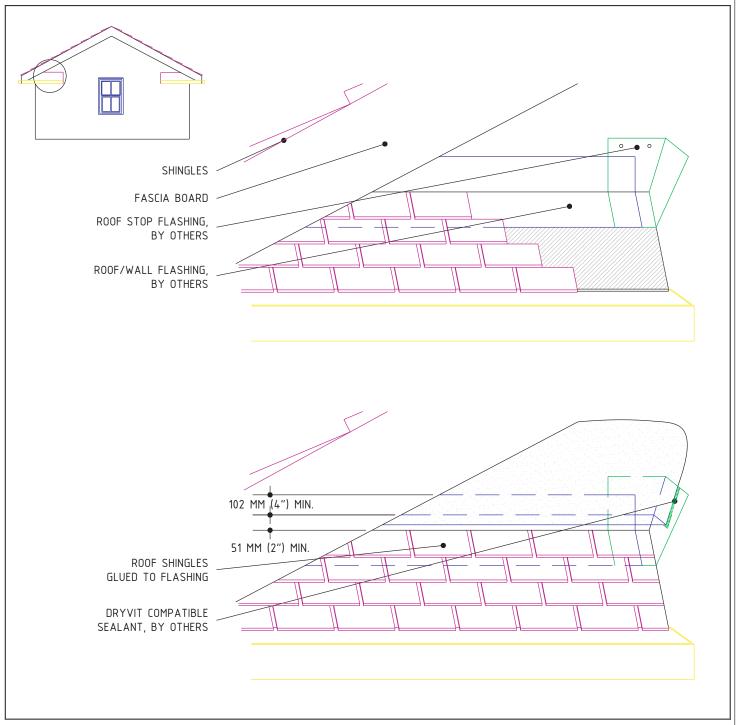


Outsulation® System

Termination at Roof Stop Flashing



APPROVED BY:	REV:	DATE:
DAW	1	05/06

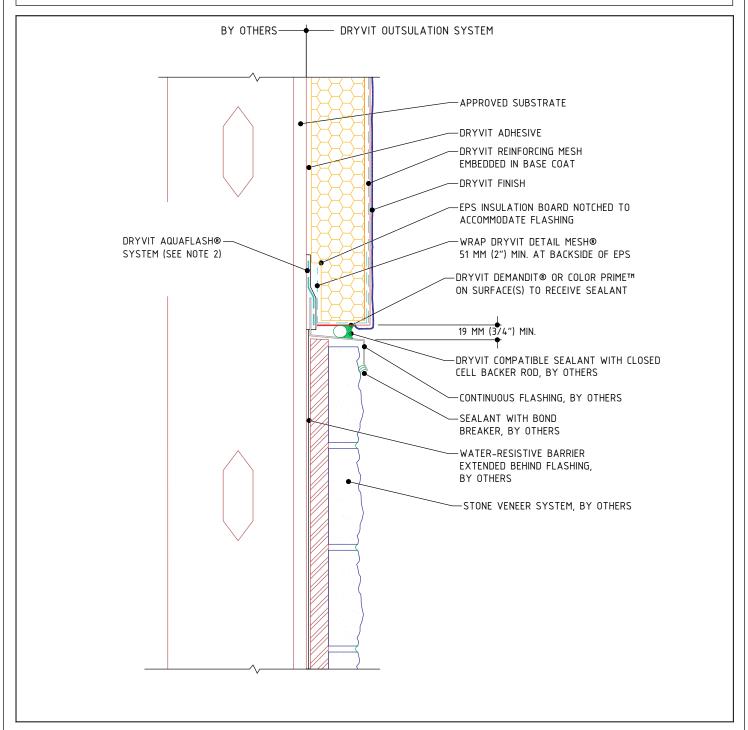

Outsulation® System

NOTE:

- 1. DRYVIT RECOMMENDS THAT GROUND FLOOR
 APPLICATIONS AND ALL FACADES EXPOSED TO
 ABNORMAL STRESS, HIGH TRAFFIC, OR DELIBERATE
 IMPACT HAVE THE BASE COAT REINFORCED WITH
 PANZER® MESH PRIOR TO STANDARD™ OR
 STANDARD PLUS™ MESH. LOCATION OF HIGH
 IMPACT ZONES SHOULD BE INDICATED ON
 CONTRACT DRAWINGS.
 - 2. DRYVIT FLASHING TAPE SURFACE CONDITIONER™ AND DRYVIT FLASHING TAPE™ MAY BE USED LIEU OF DRYVIT AQUAFLASH SYSTEM.

APPROVED BY: REV: DATE: RS 0 05/08

Horizontal Joint At Stone Veneer

